











LEGEND

-  PROPOSED RETAINING WALLS
-  EXISTING RETAINING WALLS
-  FUTURE RETAINING WALLS
-  COLORBOND FENCING - COLOUR = "GREYRIDGE"
-  OPEN FENCING
-  FINISHED GROUND LEVELS
-  23
-  RETAINING WALL REFERENCE
-  23.25
-  LOT LEVEL


NOTES:

1. RETAINING WALLS OVER 1.0m SHALL HAVE A 1.2m HIGH RINGLOCK AND STAR IRON PICKET FENCE INSTALLED ON TOP.
2. TO BE READ IN CONJUNCTION WITH RETAINING WALL LONGSECTION, STANDARD RETAINING WALL DETAILS AND EARTHWORKS DRAWINGS.
3. ADD EXTRA BLOCKS AS INDICATED ON ELECTRICAL DRAWING

WALL SETOUT INFORMATION


WALL No.	START VERGE RL	FRONT OF WALL RL	BACK OF WALL RL	TOP OF WALL RL	END VERGE RL	LENGTH
168	-	24.26	24.63	24.68	24.33	18.50
169	-	24.63	25.00	25.05	24.63	18.50
171	26.40	26.11	26.85	26.90	-	28.50
172	27.31	26.85	27.59	27.64	-	28.50
173	-	25.37	25.74	25.79	25.46	28.50
174	27.97	27.59	28.33	28.38	-	28.50
175	28.54	28.33	28.70	28.75	-	28.50
177	-	26.48	27.59	27.64	26.92	18.50
197	-	29.19	29.56	29.61	29.32	18.50
198	-	29.56	29.98	29.98	29.66	18.50
250	29.85	29.80	30.17	30.22	-	28.50
251	30.59	30.55	30.92	30.72	-	28.50

REFER STANDARD WALL DETAILS FOR TYPICAL SECTION



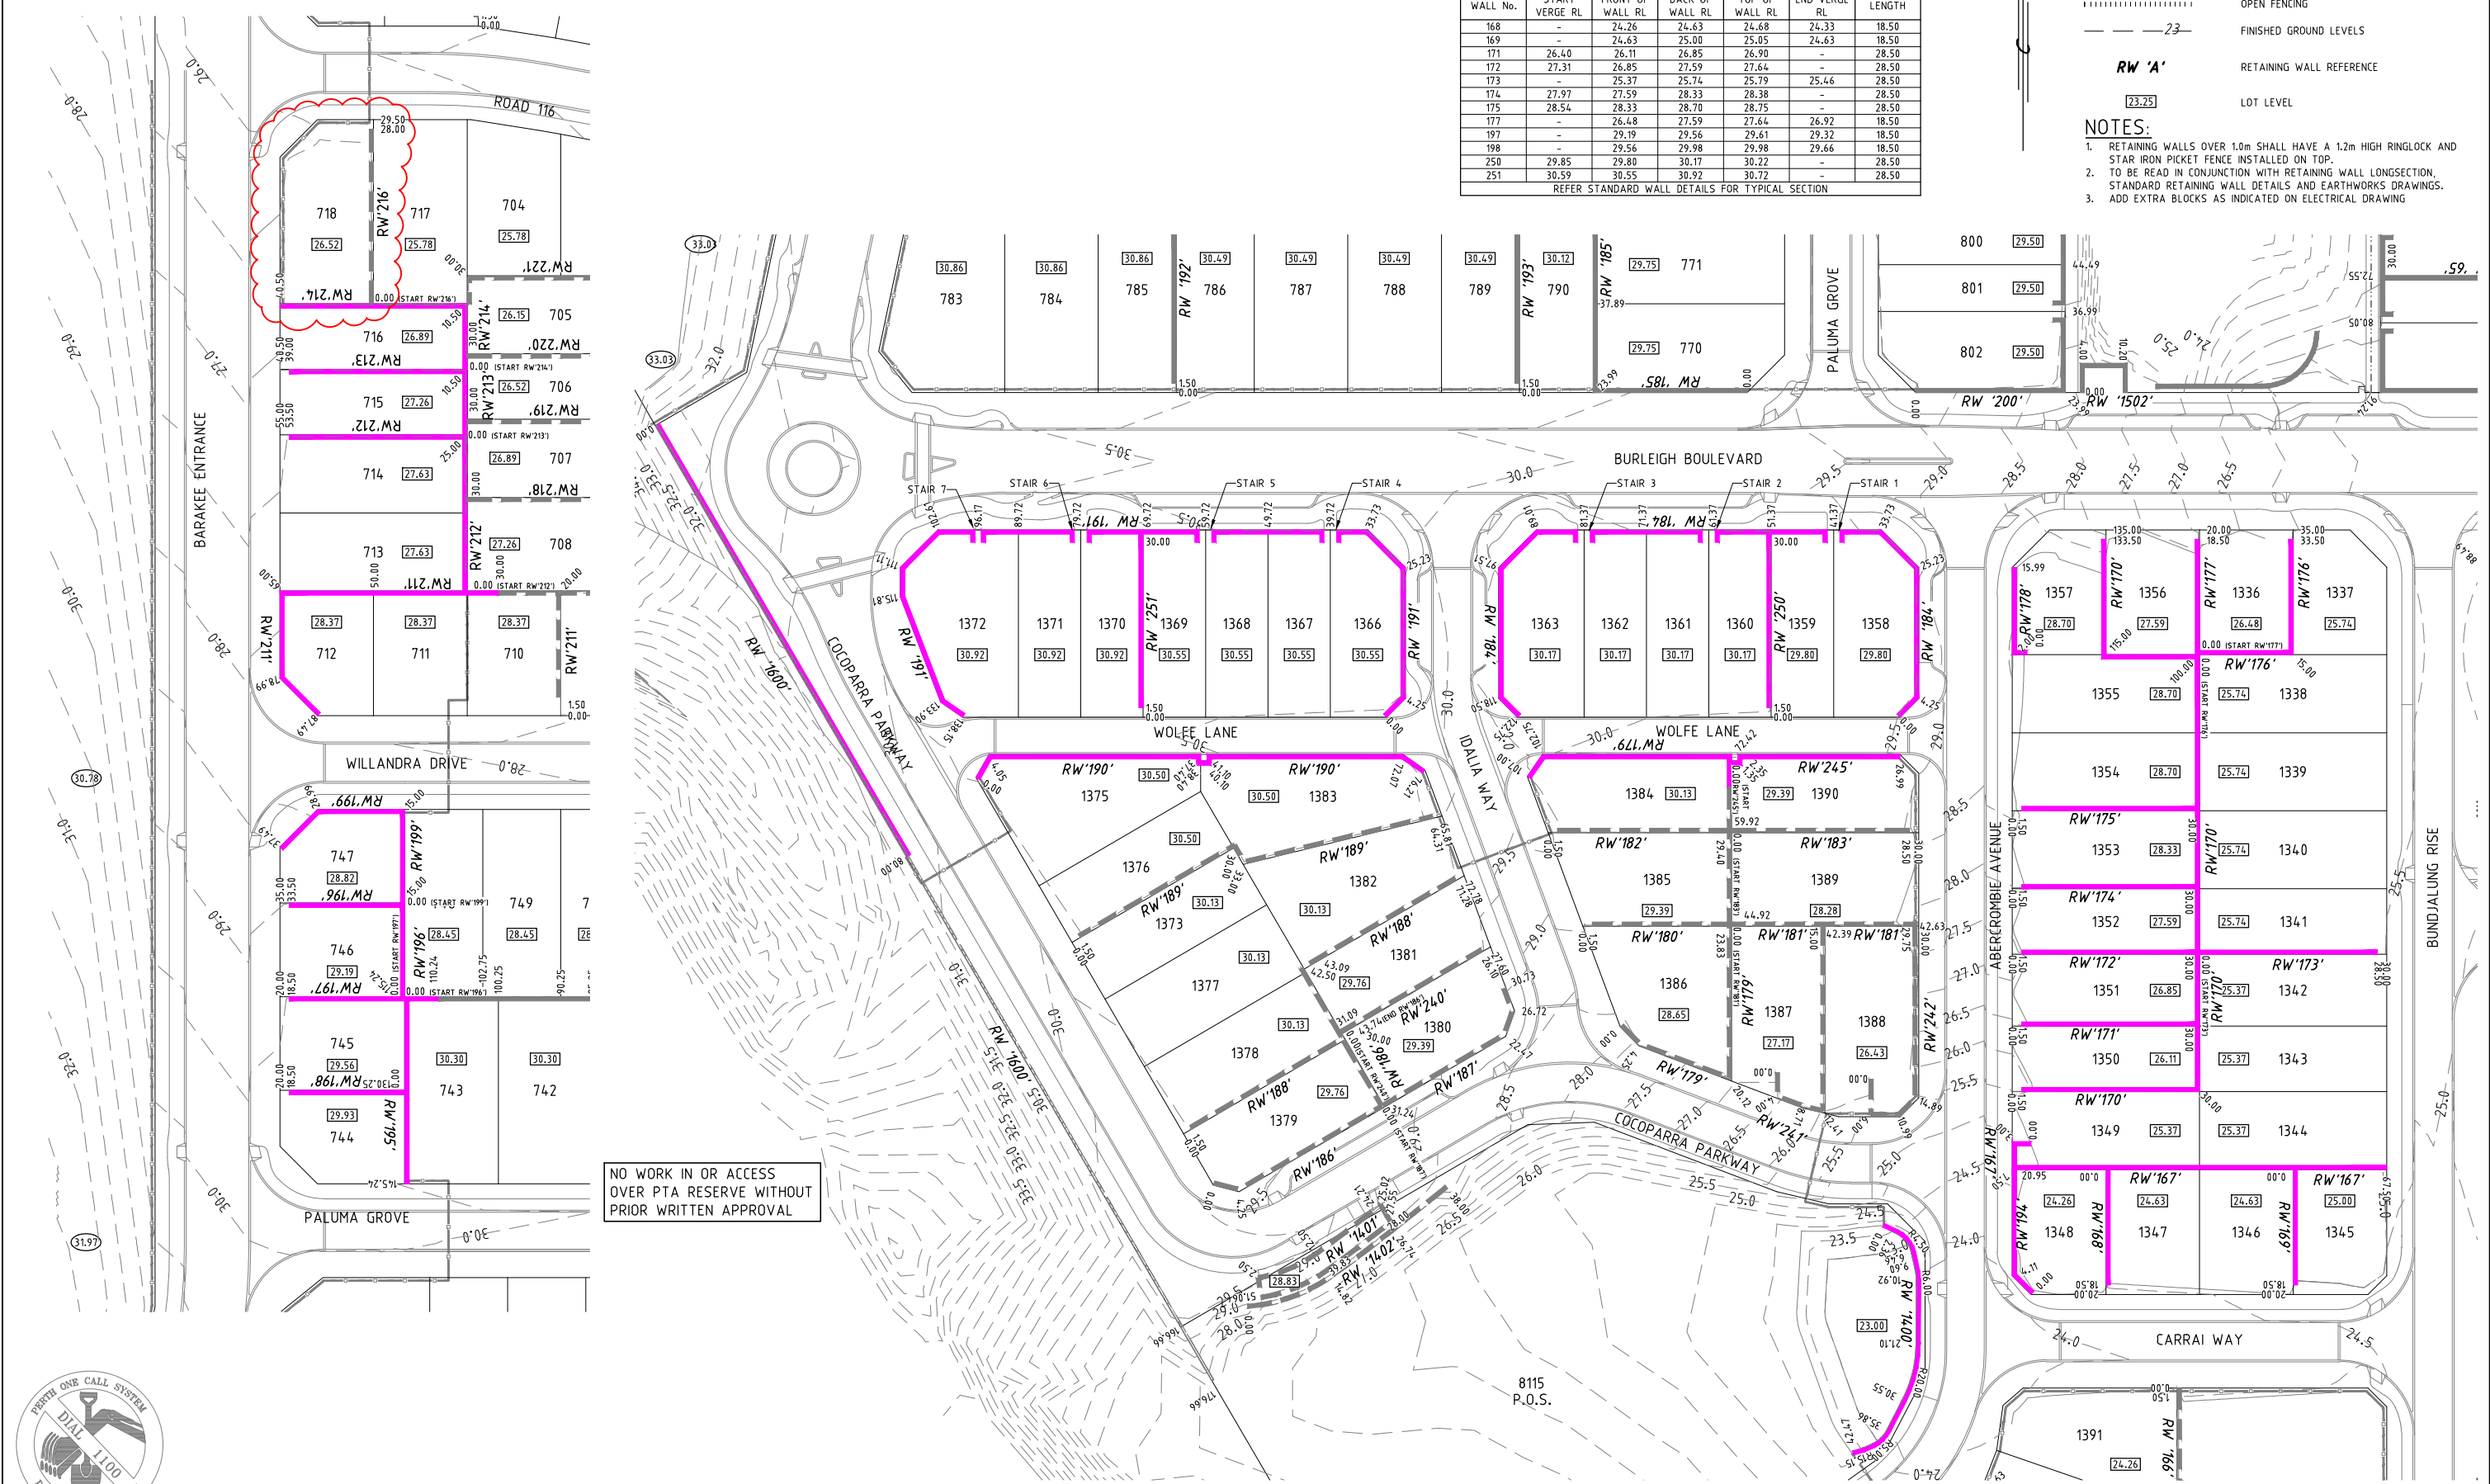


NO WORK IN OR ACCESS OVER PTA RESERVE WITHOUT PRIOR WRITTEN APPROVAL



<p>Copyright</p> <p>"This document shall remain the property of Development Engineering Consultants Pty. Ltd. The document may only be used for the purpose for which it was commissioned & in accordance with the terms of engagement for the commission. Unauthorised use of this document in any way is prohibited"</p>	<table border="1"> <tr><th>No.</th><th>DATE</th><th>BY</th><th>REVISION</th></tr> <tr><td>1</td><td>12/07/18</td><td>PMS</td><td>RETAINING WALL '215' DELETED TO SUIT LOT 718 PAD LEVEL</td></tr> <tr><td>2</td><td>20/06/18</td><td>PMS</td><td>ISSUED FOR CONSTRUCTION</td></tr> <tr><td>3</td><td>19/02/18</td><td>PMS</td><td>WALLS IN LOTS 1375, 1383 & 1390 AMENDED TO SUIT LANEWAY STREETLIGHTS, ISSUED FOR TENDER</td></tr> <tr><td>4</td><td>21/07/17</td><td>PMS</td><td>AMENDED TO SUIT LATEST PRECAL & COUNCIL COMMENTS, WALLS '250' & '251' ADDED, ISSUED FOR TENDER</td></tr> <tr><td>5</td><td>19/09/16</td><td>WJB</td><td>INITIAL ISSUE</td></tr> </table>	No.	DATE	BY	REVISION	1	12/07/18	PMS	RETAINING WALL '215' DELETED TO SUIT LOT 718 PAD LEVEL	2	20/06/18	PMS	ISSUED FOR CONSTRUCTION	3	19/02/18	PMS	WALLS IN LOTS 1375, 1383 & 1390 AMENDED TO SUIT LANEWAY STREETLIGHTS, ISSUED FOR TENDER	4	21/07/17	PMS	AMENDED TO SUIT LATEST PRECAL & COUNCIL COMMENTS, WALLS '250' & '251' ADDED, ISSUED FOR TENDER	5	19/09/16	WJB	INITIAL ISSUE	<p>CLIENT:</p> <p>DEPARTMENT OF HOUSING</p>	 <p>DEVELOPMENT ENGINEERING CONSULTANTS</p>	<p>SUITE 3, 123A COLIN ST, WEST PERTH, 6005 WESTERN AUSTRALIA Ph: (08) 9481 1900 Fax: (08) 9481 1700</p>	<p>PROJECT:</p> <p>LOT 1 YANCHEP BEACH ROAD YANCHEP JINDOWIE - STAGE 16</p> <p>W.A.P.C. No. - 150834</p>	<p>DRAWING:</p> <p>EARTHWORKS RETAINING WALL LAYOUT PLAN</p> <p>CAD DRAWING DO NOT MANUALLY ALTER</p>	<table border="1"> <tr><th>SCALE</th><th>DRAWN</th><th>CHECK</th><th>REV No.</th></tr> <tr><td>1:500</td><td>WJB</td><td>RDG</td><td>1</td></tr> <tr><th>DATE</th><th>DESIGNED</th><th>APPROVED</th><td></td></tr> <tr><td>SEP '16</td><td>WJB</td><td>RDG</td><td></td></tr> </table> <p>PROJECT NUMBER: YANAUS47 E02 DRAWING NUMBER: YANAUS47 E02.dwg 12/07/2018</p>	SCALE	DRAWN	CHECK	REV No.	1:500	WJB	RDG	1	DATE	DESIGNED	APPROVED		SEP '16	WJB	RDG	
No.	DATE	BY	REVISION																																												
1	12/07/18	PMS	RETAINING WALL '215' DELETED TO SUIT LOT 718 PAD LEVEL																																												
2	20/06/18	PMS	ISSUED FOR CONSTRUCTION																																												
3	19/02/18	PMS	WALLS IN LOTS 1375, 1383 & 1390 AMENDED TO SUIT LANEWAY STREETLIGHTS, ISSUED FOR TENDER																																												
4	21/07/17	PMS	AMENDED TO SUIT LATEST PRECAL & COUNCIL COMMENTS, WALLS '250' & '251' ADDED, ISSUED FOR TENDER																																												
5	19/09/16	WJB	INITIAL ISSUE																																												
SCALE	DRAWN	CHECK	REV No.																																												
1:500	WJB	RDG	1																																												
DATE	DESIGNED	APPROVED																																													
SEP '16	WJB	RDG																																													




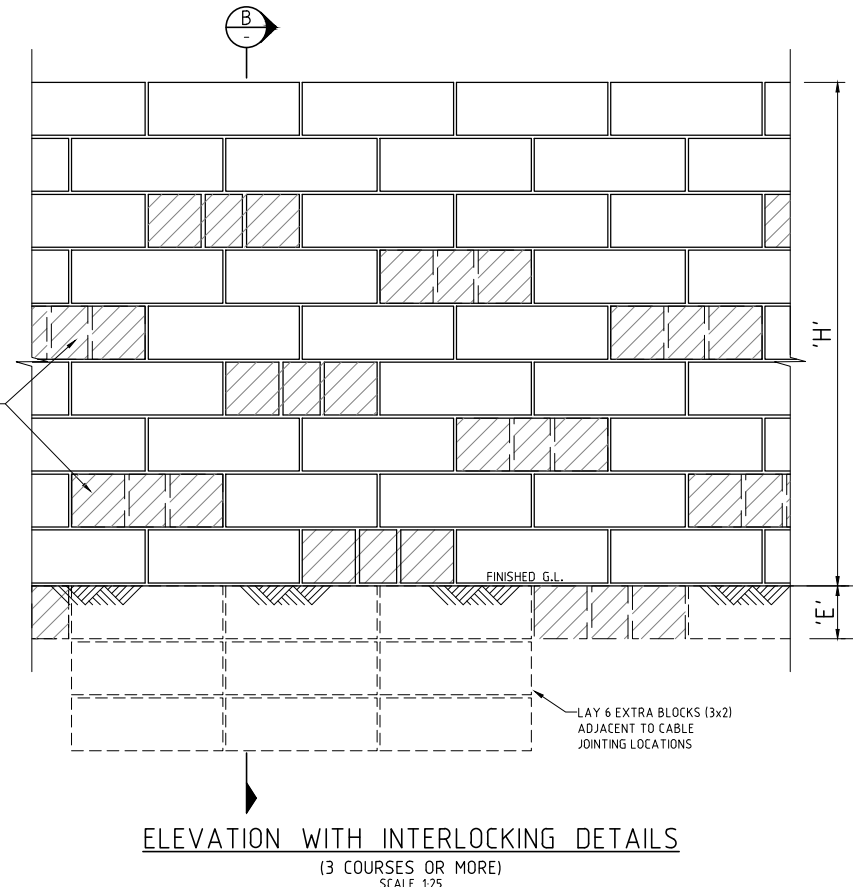
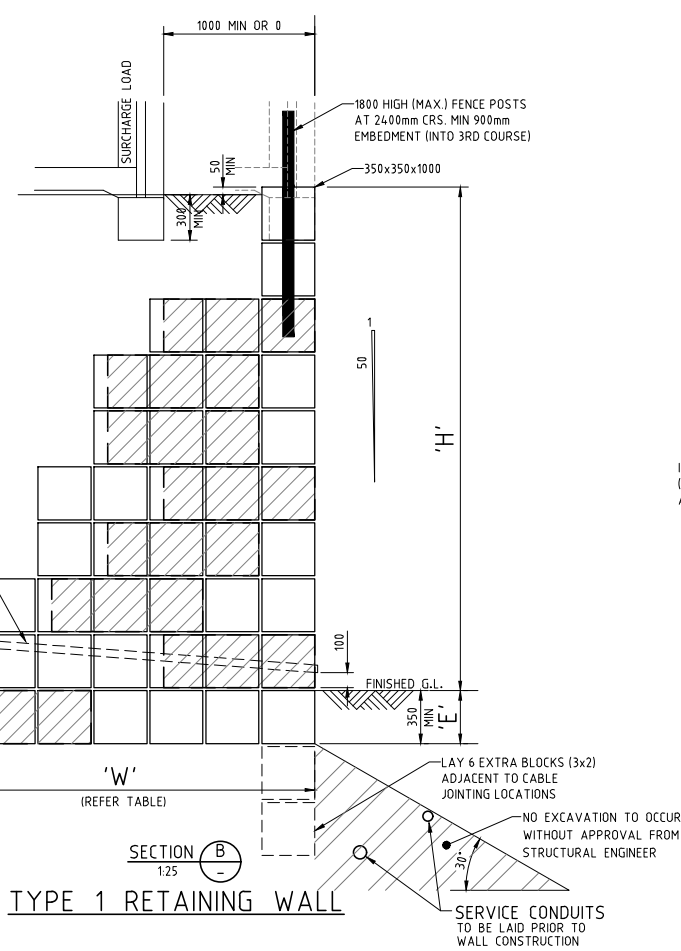
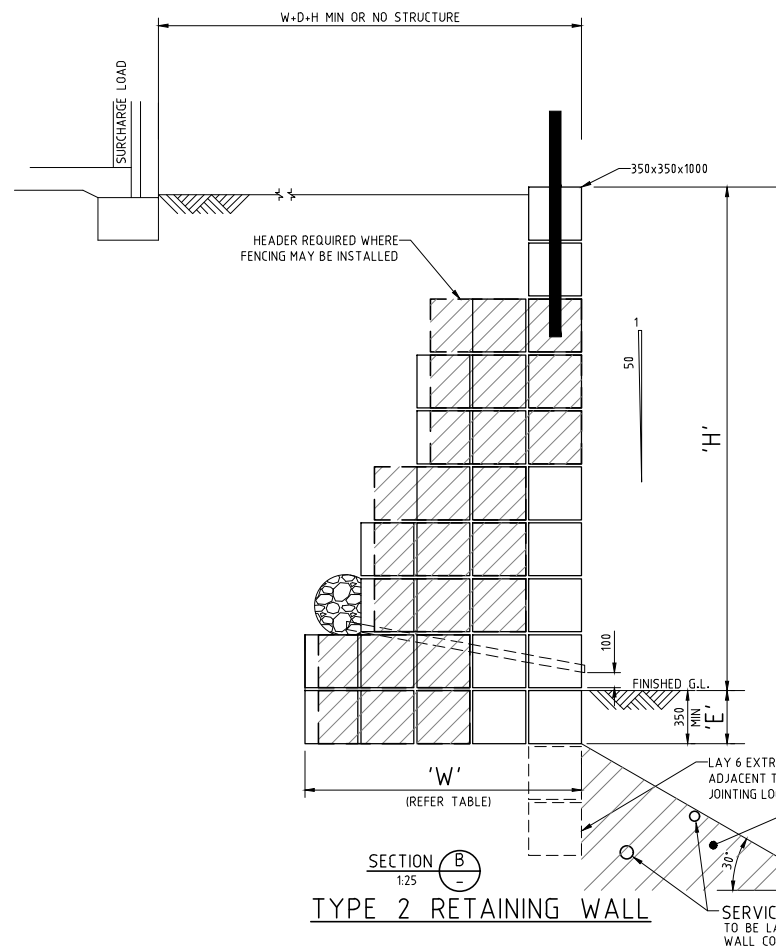


TYPE 1 & 2 WALL DIMENSIONS


NO. OF COURSES	TOTAL HEIGHT "H" + "E"	MAX. EFFECTIVE HEIGHT "H"	MIN. BASE WIDTH "W"	
			TYPE 1	TYPE 2
2*	720	520(A)	720	350(B)
3	1090	740	1000	720
4	1460	1110	1370	1000
5	1830	1480	1740	1000
6	2200	1850	2110	1090
7	2570	2220	2480	1370
8	2940	2590	2850	1740
9	3310	2960	3220	2110
10	3680	3330	3590	2480
11	4050	3700	3960	2850
12	4420	4070	4330	3220
13	4790	4440	4700	3590
14	5160	4790	5070	3960
15	5530	5180	5440	4330
16	5900	5550	5810	4700
17	6270	5920	6180	5070
18	6640	6290	6550	5440

TYPE 1 = STRUCTURAL RETAINING WALL - STRUCTURE TO BE ON BOUNDARY OR MIN. 1.0m AWAY.

TYPE 2 = NON STRUCTURAL RETAINING WALL - NO STRUCTURE OR OFFSET MIN. OF (H + W + D)

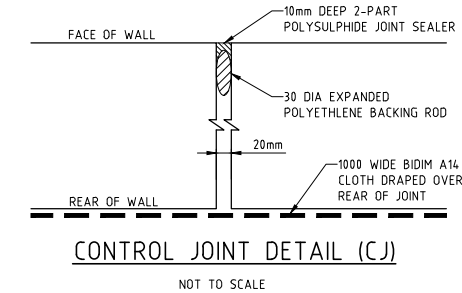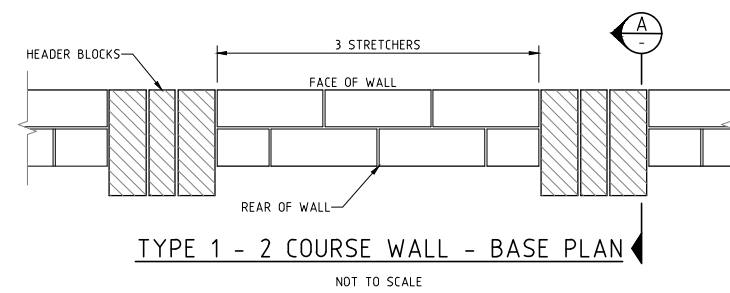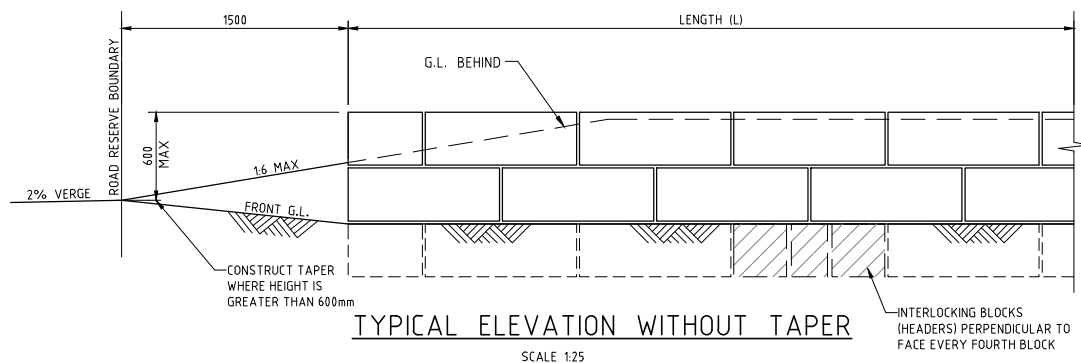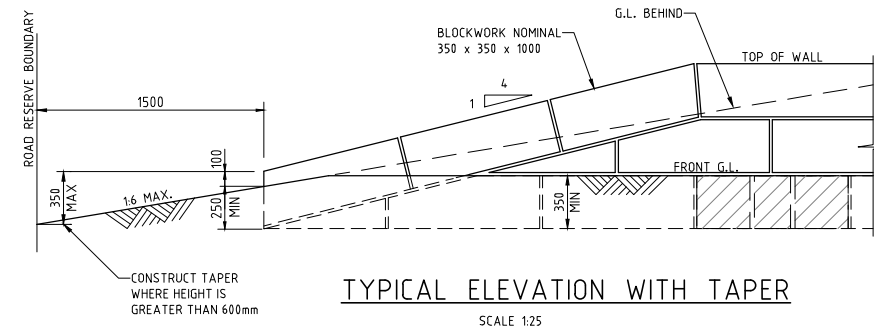

***NOTE:**
 (A) - ALL 2 COURSE WALLS REQUIRE ONLY 200mm MINIMUM EMBEDMENT (U.N.D.)
 (B) - FOR TYPE 2 - 2 COURSE WALLS HEADER BLOCKS ARE NOT REQUIRED

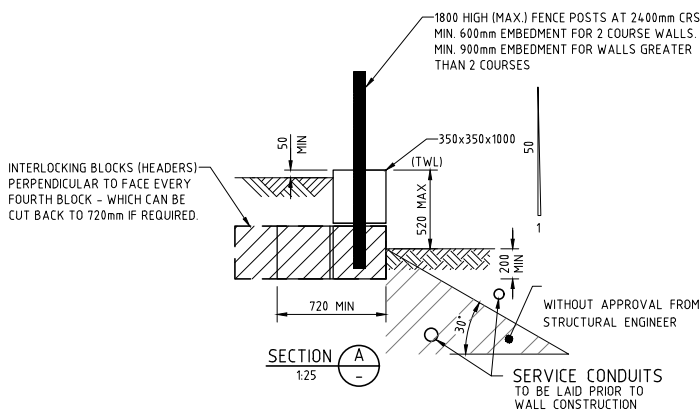

NOTES:

- DESIGN**
THE WALL IS DESIGNED FOR STABLE SAND (CLASS 'A1' OR SLIGHTLY REACTIVE CONDITIONS (CLASS 'S')) TO AS2870, WITH FREE DRAINING GRANULAR BACKFILL AND MIN 600mm SAND PAD BELOW BASE. FOUNDATION TO BE FREE OF DELETERIOUS MATERIAL. MAXIMUM WATER TABLE TO BE BELOW BOTTOM OF WALL. IF OTHER CONDITIONS ARE ENCOUNTERED ON SITE, CONTACT THE ENGINEER PRIOR TO CONSTRUCTION.
- WALL TYPE 1**
DEAD LOADS (INCLUDING BUILDINGS) PLACED BEHIND WALLS SHOULD BE NO CLOSER THAN 1.0m UNLESS LOCATED DIRECTLY ON TOP. MAXIMUM SURCHARGE LOAD TO BE 40kN/m WHICH ALLOWS FOR A TWO STOREY BUILDING.
- WALL TYPE 2**
ENSURE DEAD LOAD (INCLUDING BUILDINGS) PLACED BEHIND WALLS IS NO CLOSER TO THE WALL THAN A DISTANCE EQUAL TO H+E+W. MAXIMUM SURCHARGE LOAD TO BE 2.5kPa WHICH INCLUDES LIGHT VEHICLE SURCHARGE.
- COMPACTION**
COMPACT THE SOIL AT THE BASE TO 100kPa ALLOWABLE BEARING CAPACITY OR 95% MODIFIED MAXIMUM DRY DENSITY FOR A MINIMUM DEPTH OF 600mm BELOW BASE OF WALL.
- LIMESTONE**
LIMESTONE TO BE RECONSTITUTED BLOCKS (MINIMUM DENSITY OF 1800kg/m AND MINIMUM COMPRESSIVE STRENGTH OF 2MPa). FULL BLOCKS TO BE 350x350x1000, HALF BLOCKS TO BE 165x350x1000. ALTERNATIVELY 240x350x100 BLOCKS CAN BE USED TO MEET MINIMUM WALL DIMENSIONS. BLOCKS ARE TO BE LAID IN STRETCHER BOND. LIMESTONE TO BE FREE FROM SOFT POCKETS AND GENERALLY FREE FROM SURFACE DEFECTS.
- INTERLOCKING BLOCKS**
FOR WALL TYPE 1 AND/OR WHEN FENCE POSTS ARE TO BE CORE DRILLED INTO WALL, PROVIDE INTERLOCKING BLOCKS (HEADERS) AT 4m CENTRES. LOCATE AT 3c AND EACH COURSE THEREAFTER WITH INTERLOCKING SETS TO BE STAGGERED WITH ADJACENT COURSE.
- JOINTS**
ALL JOINTS ARE TO BE MORTARED WITH 1:16 (CEMENT:LIME:SAND). MORTAR TO BE M3 CLASSIFICATION, EXCEPT PROJECTS LOCATED WITHIN 1km OF THE OCEAN ARE TO BE M4 CLASSIFICATION. CEMENTS OTHER THAN TYPE GP PORTLAND CEMENT & 100% WHITE PORTLAND CEMENT SHALL NOT BE USED. RUBBLE NOT TO BE USED TO FILL VOIDS. ALL JOINTS ARE TO BE 20mm.
- BACKFILL**
DO NOT BACKFILL WALL UNTIL AT LEAST 7 DAYS AFTER COMPLETION. BACKFILL TO BE COMPACTED TO A 95% MODIFIED MAXIMUM DRY DENSITY OR EQUIVALENT.
- CONTROL JOINTS**
PROVIDE 20mm CONTROL JOINTS WHERE SHOWN ON DESIGN DRAWINGS OR OTHERWISE AT MAX 40m CENTRES IN STRAIGHT LENGTHS OF WALLS. WHERE WALL CHANGES DIRECTION, CONTROL JOINTS ARE LOCATED 1m FROM THE CORNER FOR WALLS TO 4c IN HEIGHT, 1.5m FOR WALLS BETWEEN 5c AND 8c IN HEIGHT, AND 2m FROM THE CORNER FOR WALLS 9c AND ABOVE. FILL JOINTS WITH 30DIA EXPANDED POLYETHYLENE BACKING ROD, COVERED WITH A 10mm 2-PART POLYSULPHIDE JOINT SEALER.
- LOCATION**
RETAINING WALLS TO BE LOCATED WHOLLY WITHIN THE RETAINED LOT. FOOTING BLOCKS SHALL BE LOCATED TO A MAXIMUM TOLERANCE OF 25mm WITHIN THE RETAINED LOT, AND 0mm OUTSIDE THE CADASTRAL BOUNDARY OF THE RETAINED LOT.
- COMPLETION**
THE CONTRACTOR SHALL PROVIDE WRITTEN CERTIFICATION OF PRACTICAL COMPLETION THAT THE WALL CONSTRUCTION AND BACKFILLING HAS BEEN CARRIED OUT IN ACCORDANCE WITH THIS DRAWING & SPECIFICATIONS. ALL WALLS FACING ROAD RESERVES, P.A.W.'S & P.O.S.'S ARE TO BE TREATED WITH A NON SACRIFICIAL ANTI-GRAFFITI COATING.



NO.	DATE	BY	REVISION
1	12/07/18	PMS	DETAILS UPDATED
0	20/06/18	PMS	ISSUED FOR CONSTRUCTION
B	21/07/17	PMS	OPEN FENCE, PIER & GATE DETAILS REMOVED, ISSUED FOR TENDER
A	19/09/16	WJB	INITIAL ISSUE

CLIENT:
DEPARTMENT OF HOUSING

DEVELOPMENT ENGINEERING CONSULTANTS
 SUITE 3, 123A COLIN ST. WEST PERTH, 6005 WESTERN AUSTRALIA
 Ph: (08) 9481 1900 Fax: (08) 9481 1700

PROJECT:
LOT 1 YANCHEP BEACH ROAD YANCHEP JINDOWIE - STAGE 16
 W.A.P.C. No. - 150834

DRAWING:
EARTHWORKS RETAINING WALL STANDARD DETAILS

SCALE	AS SHOWN	DRAWN	WJB	CHECK	RDG	REV No.
DATE	MAR '15	DESIGNED	WJB	APPROVED	RDG	1
PROJECT NUMBER	DRAWING NUMBER					
YANAUS47 E06						